


HEATMISER WIRELESS SYSTEM

- PAIRING THE RECEIVER TO THE THERMOSTAT**
- STEP 1:** SET THE UH1-W NETWORK ID NUMBER ON THE ROTARY SWITCH
 - STEP 2:** SET THE PRT-W FEATURE 6 TO 00
 - STEP 3:** SET THE PRT-W FEATURE 7 TO MATCH THE UH1-W NUMBER SET IN STEP 1
 - STEP 4:** SET THE PRT-W FEATURE 9 TO 00 FOR UNDERFLOOR

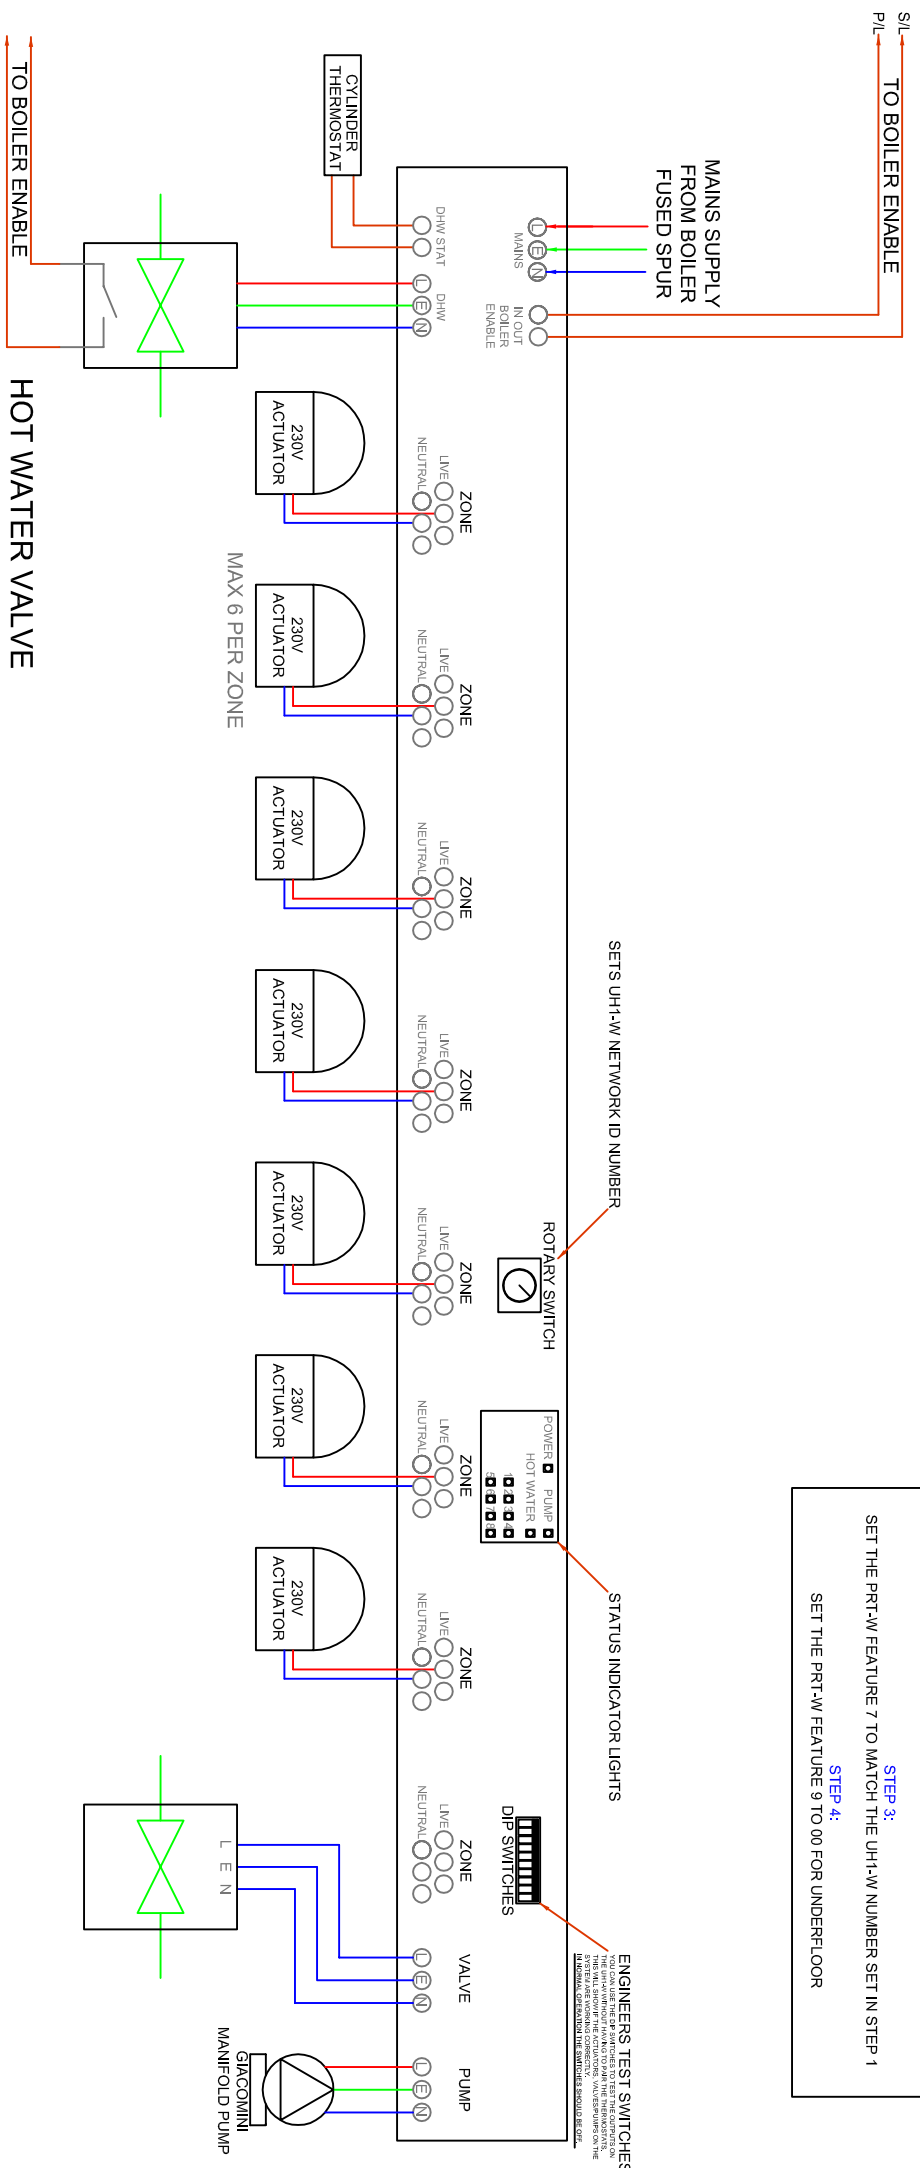

ENGINEERS TEST SWITCHES
 YOU CAN USE THE 6P SWITCHES TO TEST THE CONNECTION. THIS IS ONLY TO BE USED FOR TESTING PURPOSES. THIS DOES NOT SUPPORT THE ACTUATORS. VALVES SHOULD BE ON THE MANUAL OPERATED THE SWITCHES SHOULD BE OFF.

FOR FURTHER INFORMATION PLEASE CONTACT HEATMISER ON 01254 669090

COURTESY OF **Heatmiser UK Ltd**